

INTERIOR ICE RINK

585 Main Street

Woodbridge, New Jersey

07095

ARCHITECTS & PLANNERS

The Vaughn Collaborative

300 Phillips Blvd. - Suite 500, Ewing, NJ 08618 Telephone: 609-530-7400

ICE RINK CONSULTANT

MacLaughlin Management & Design

PO Box 45, Exeter, New Hampshire
Telephone: 603-686-0423

ABBREVIATIONS

ABBREVIATIONS ON THE LIST BELOW ARE STANDARD ABBREVIATIONS AND NOT ALL ARE USED FOR THIS PROJECT. IF AN ABBREVIATION CONFLICTS WITH THE DRAWINGS, NOTIFY ARCHITECT PRIOR TO THE START OF ANY DEMOLITION AND / OR CONSTRUCTION ACTIVITY.

- & AND
- AT
- # NUMBER
- + PLUS OR MINUS
- AD ACCESS DOOR
- AFV ABOVE FINISHED FLOOR
- AHU AIR HANDLING UNIT
- ARCH ARCHITECTURAL
- APPROX APPROXIMATE
- BD BOARD
- BF BOARD FEET
- BLDG BUILDING
- CF CUBIC FEET
- CJ CONTROL JOINT
- CMU CONCRETE MASONRY UNIT
- CONC CONCRETE
- CONSTR CONSTRUCTION
- CONT CONTINUOUS
- DEG DEGREES
- DIA DIAMETER
- DN DOWN
- EA EACH
- ELEC ELECTRIC OR ELECTRICAL
- ETFORM ETRUKLE-PROPKLENE-DIENE-MONOMER
- EQ EQUAL
- EQUIP EQUIPMENT
- EXIST EXISTING
- EXP JT EXPANSION JOINT
- EW EACH WAY
- FE FIRE EXTINGUISHER
- FEC FIRE EXTINGUISHER CABINET
- FIN FINISH OR FINISHED
- GALV GALVANIZED
- HET HORIZONTAL EACH FACE
- HM HOLLOW METAL
- HORIZ HORIZONTAL
- INSUL INSULATION
- LF LINEAR FEET
- LLH LONG LEG HORIZONTAL
- LLV LONG LEG VERTICAL
- MAX MAXIMUM
- MFR MANUFACTURER
- MIN MINIMUM
- M.O. MASONRY OPENING
- O/C ON CENTER
- OPP OPPOSITE
- PLYWD PLYWOOD
- PT POINT
- PTD PAINTED
- RAD RADIUS
- RD ROOF DRAIN
- REBAR REINFORCING BAR
- RENF REINFORCED
- REQD REQUIRED
- RO ROUGH OPENING
- RV RIDGE VENT
- RWC RAIN WATER CONDUCTOR
- S/S STAINLESS STEEL
- SB SPLASH BLOCK
- SF SQUARE FEET
- SIM SIMILAR
- STL STEEL
- SY SQUARE YARD
- TAB TOP & BOTTOM
- TYP TYPICAL
- V VENT
- VEF VERTICAL EACH FACE
- VERT VERTICAL
- VF VERIFY IN FIELD
- WD WOOD
- WWF WELDED WIRE FABRIC

GRAPHIC SYMBOLS

GRAPHIC SYMBOLS BELOW ARE STANDARD SYMBOLS, AND NOT ALL ARE USED FOR THIS PROJECT.

SYMBOLS USED EXCLUSIVELY ON REFLECTED CEILING PLANS APPEAR ON SHEET A7.1 IN THIS DRAWING SET.

- NORTH ARROW
- ELEVATION / SECTION FLAG
- PLAN DETAIL FLAG
- DOOR NUMBER
- ROOM NAME AND NUMBER
- KEY NOTE
- 1-HOUR RATED PARTITION
- 2-HOUR RATED PARTITION
- MATERIAL TO REMAIN
- MATERIAL DEMOLITION
- MATERIAL CONSTRUCTION
- PARTITION TYPE
- EXISTING ELEVATION / LOCATION BENCHMARK
- NEW ELEVATION / LOCATION BENCHMARK
- SURFACE MOUNTED FIRE EXTINGUISHER CABINET
- SEMI-RECESSED FIRE EXTINGUISHER CABINET
- SEMI-RECESSED, FIRE RATED, FIRE EXTINGUISHER CABINET
- BRACKET-MOUNTED FIRE EXTINGUISHER
- WALL MOUNTED EXIT LIGHT FIXTURE
- CEILING MOUNTED EXIT LIGHT FIXTURE
- PENDANT MOUNTED EXIT LIGHT FIXTURE
- WALL MOUNTED FIRE ALARM HORN / STROBE
- WALL MOUNTED FIRE ALARM PULL STATION

GENERAL PROJECT NOTES

1. WHEREVER CONFLICTS EXIST BETWEEN THE DRAWING GRAPHICS, NOTES AND SPECIFICATIONS, THE MORE STRINGENT CONDITION SHALL GOVERN.
2. CONTRACTOR SHALL PROVIDE, TO ALL PERSONNEL ON THE WORK SITE, ALL APPLICABLE HEALTH AND SAFETY EQUIPMENT, PERTINENT TO COVID-19.
3. ANY MINOR OMISSION FROM THE DOCUMENTS, WHICH WOULD CUSTOMARILY BE PART OF THE SYSTEM OR FINISHES, SHALL BE PROVIDED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER.
4. THE CONTRACTOR SHALL APPLY, PAY FOR AND SECURE ALL NECESSARY PERMITS.
5. THE ARCHITECT WILL NOT BE RESPONSIBLE WHERE CONSTRUCTION DEVIATES FROM THE DRAWINGS.
6. ALL WORK AND MATERIALS SHALL MEET THE REQUIREMENTS OF THE CONTRACT DOCUMENTS, THE STATE AND LOCAL CONSTRUCTION CODES AND ALL AUTHORITIES HAVING JURISDICTION.
7. ALL WRITTEN DIMENSIONS SHALL GOVERN, DO NOT SCALE THE DRAWINGS.
8. CONTRACTOR SHALL REVIEW ALL CONTRACT DOCUMENTS FOR THE EXTENT OF THE WORK TO BE COMPLETED AND COORDINATED.
9. CONTRACTOR SHALL CHECK AND VERIFY ALL PLAN DIMENSIONS AND CONDITIONS PRIOR TO PROCEEDING WITH CONSTRUCTION. SHOULD QUESTIONS ARISE, THE CONTRACTOR SHALL NOTIFY THE OWNER AND ARCHITECT, IN WRITING, PRIOR TO PROCEEDING WITH THE WORK.
10. RE-CHECK MEASUREMENTS AND DIMENSIONS BEFORE STARTING EACH INSTALLATION. INSPECT BOTH THE SUBSTRATE AND THE CONDITIONS FOR EACH MAJOR COMPONENT. DO NOT PROCEED UNTIL ANY UNSATISFACTORY CONDITION(S) HAVE BEEN CORRECTED IN AN ACCEPTABLE MANNER.
11. THE DRAWINGS SHOW THE GENERAL ARRANGEMENT AND EXTENT OF THE WORK. AS THE WORK PROGRESSES, THE CONTRACTOR, AT NO EXTRA COST, SHALL MAKE MODIFICATIONS TO MAKE PARTS ALIGN.
12. COMPLY WITH MANUFACTURERS INSTALLATION INSTRUCTIONS AND RECOMMENDATIONS TO THE EXTENT THAT THOSE INSTRUCTIONS AND RECOMMENDATIONS ARE MORE EXPLICIT OR STRINGENT THAN REQUIREMENTS CONTAINED IN CONTRACT DOCUMENTS.
13. PROVIDE ATTACHMENTS AND CONNECTION DEVICES AND METHODS NECESSARY FOR SECURING WORK. SECURE WORK TRUE TO LINE AND LEVEL. ALLOW FOR EXPANSION AND BUILDING MOVEMENT.
14. CONTRACTOR SHALL PROVIDE A DUMPSTER FOR THEIR USE. REMOVE FROM THE SITE EXCESS EXCAVATED MATERIALS, TRASH, DEBRIS, AND WASTE MATERIALS. DISPOSAL SHALL BE IN A MANNER APPROVED BY STATE AND LOCAL AUTHORITIES. ALL WASTE MATERIALS SHALL BE REMOVED IN A MANNER WHICH PREVENTS INJURY OR DAMAGE TO PERSONS, AND PUBLIC RIGHT OF WAY.
15. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING A SAFE WORK AREA AND IS RESPONSIBLE FOR SAFETY AT THE SITE.
16. THE CONTRACTOR SHALL PROVIDE ANY REQUIRED PROTECTION OF WORK. NOTHING HEREIN CONTAINED SHALL BE CONSTRUED TO NULLIFY ANY RULES, REGULATIONS OR STATUTES OF STATE OR FEDERAL AGENCIES GOVERNING THE PROTECTION OF THE PUBLIC WORKERS FROM HEALTH OR OTHER HAZARDS INVOLVED IN THE OPERATIONS REQUIRED TO PERFORM THIS WORK.
17. CONSTRUCT AND INSTALL TEMPORARY PROTECTION MEASURES PRIOR TO START OF CONSTRUCTION. TEMPORARY PROTECTION SHALL BE REMOVED WHEN WORK IS COMPLETE. THE CONTRACTORS SHALL AT ALL TIMES PRESERVE AND PROTECT THE SITE, BUILDING OR STRUCTURE FROM DAMAGE OR INJURY.
18. ALL CONSTRUCTION EQUIPMENT AND SAFEGUARDS SHALL BE CONSTRUCTED, INSTALLED AND MAINTAINED IN A SUBSTANTIAL MANNER AND SHALL BE SO OPERATED AS TO INSURE PROTECTION TO THE WORKERS ENGAGED THEREON AND TO THE GENERAL PUBLIC. ALL EXISTING AND ADJOINING IMPROVEMENTS SHALL BE PROTECTED FROM DAMAGE INCIDENTAL TO CONSTRUCTION OPERATIONS.
19. PROTECT EXISTING ROADWAYS, WALKWAYS AND ADJOINING PROPERTIES. THE CONTRACTOR SHALL AT ALL TIMES PRESERVE AND PROTECT THE SITE FROM DAMAGE OR INJURY.
20. MATERIALS AND EQUIPMENT REQUIRED IN CONSTRUCTION OPERATIONS SHALL BE STORED AND PLACED SO AS NOT TO ENDANGER OR OBSTRUCT THE PUBLIC, THE WORKERS OR THE ADJOINING PROPERTY.
21. COORDINATE WITH THE OWNER FOR SITE ACCESS AND MATERIAL STAGING AREAS DURING CONSTRUCTION.
22. THE CONTRACTOR IS RESPONSIBLE FOR ALL TEMPORARY UTILITIES REQUIRED, INCLUDING PROVISION OF PORTABLE TOILET FACILITIES.
23. ITEMS TO REMAIN ARE INDICATED ON THE DRAWINGS AND/OR AS SPECIFICALLY NOTED. HOWEVER, THE DRAWINGS AND NOTES ARE NOT TOTALLY INCLUSIVE. ITEMS TO REMAIN SHALL BE PROTECTED THROUGHOUT THE DURATION OF THE PROJECT. REPAIR TO ALL DAMAGE INFLECTED TO ITEMS TO REMAIN SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY.
24. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE OWNER'S REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR REMOVING ALL RUBBISH AND WASTE AS REQUIRED, THROUGHOUT THE COURSE OF CONSTRUCTION ACCUMULATED ON THE SITE FROM WORK BY ITS OWN EMPLOYEES AND SUBCONTRACTORS. ALL DEBRIS SHALL BE REMOVED FROM THE CONSTRUCTION SITE DAILY AND IN ACCORDANCE WITH OWNERS' REQUIREMENTS AND DIRECTION.

CONSTRUCTION CODE CRITERIA

BLEACHER DEFINITION: TIERED SEATING SUPPORTED ON A DEDICATED STRUCTURAL SYSTEM, AND TWO OR MORE ROWS HIGH, AND IS NOT A BUILDING ELEMENT.

ZONING CRITERIA:

LAND USE ZONE: B3 HIGHWAY BUSINESS; FROM ZONING MAP, LAST UPDATED SEPT. 2018.

YARD SETBACKS: FRONT = 50 FEET SIDE = 15 FEET REAR = 40 FEET

MAXIMUM PERMITTED LOT COVERAGE: 25%

EXISTING LOT AREA: 255,100 ± SQUARE FEET

EXISTING BUILDING AREA: 94,132 SQUARE FEET

PERCENTAGE OF EXISTING BUILDING AREA TO LOT AREA: 35.82%

PROPOSED ADDITION BUILDING AREA: 4,836 SQUARE FEET

PROPOSED TOTAL BUILDING AREA: 98,968 SQUARE FEET

USE GROUP, CONSTRUCTION TYPE AND OCCUPANCY CRITERIA

EXISTING BUILDING USE GROUP IS A-3, GYMNASIUM, INDOOR POOL AND TENNIS COURTS WITHOUT SPECTATOR SEATING.

PROPOSED USE GROUP FOR THE BUILDING PORTION HOUSING THE SKATING RINK ONLY, SHALL BE A-4, SKATING RINK WITH SPECTATOR SEATING.

SPECTATOR SEATING SHALL BE PRE-MANUFACTURED METAL BLEACHERS W/ SELF-SUPPORTING STRUCTURAL SYSTEM CODE GOVERNING THE SPECTATOR SEATING IS 2013-ICC-300 STANDARD ON BLEACHERS, FOLDING AND TELESCOPIC SEATING AND GRANDSTANDS, CHAPTERS 2, 3 AND 4 ONLY.

FIRE SEPARATION OF USE GROUPS A-3 AND A-4, WITHIN THE EXISTING STRUCTURE, IS NOT REQUIRED, PER IBC TABLE 508.4.

EXISTING BUILDING CONSTRUCTION TYPE = 2B

MAXIMUM PERMITTED FLOOR AREA, FOR THE EXISTING STRUCTURE, IS 38,000 SQUARE FEET.

ACCORDING TO IBC 506.3.3, THE AREA INCREASE PERMITTED IS 5.7%.

ADJUSTED MAXIMUM PERMITTED FLOOR AREA IS 40,166 SQUARE FEET.

THE EXISTING BUILDING EXCEEDS THIS LIMITATION, BUT IS PERMITTED AS AN EXISTING CONDITION. ANY PROPOSED ADDITION MUST BE SEPARATED BY A FIRE PARTITION.

ALL ADDITIONS SHALL BE CONSTRUCTION TYPE 2B.

FACILITY OCCUPANCY LOAD SHALL BE BASED UPON THE FOLLOWING CRITERIA:

SPECTATOR OCCUPANCY: BLEACHER CAPACITY = 18 INCHES OF SEATING WIDTH PER PERSON.

SKATER OCCUPANCY: RINK AREA DIVIDED BY 50 GROSS SQUARE FEET PER PERSON.

NHL REGULATION RINK = 16,625 SF ± (EQUATES TO 167 PERSONS PER GENDER).

2018 NATIONAL STANDARD PLUMBING CODE:
QUANTITY OF REQUIRED PLUMBING FIXTURES FOR USE GROUP A-4

PERSONS	WC-MALE	WC-FEMALE	LAV-MALE	LAV-FEMALE
1 TO 100	2	2	2	2
101 TO 200	ADD 2	ADD 2	ADD 2	ADD 2
201 TO 400	ADD 2	ADD 2	ADD 2	ADD 2
EA. ADD'L 400	ADD 2	ADD 4	ADD 1	ADD 2

DRINKING FOUNTAINS: PROVIDE 1 FOR EACH 500 PERSONS, OR FRACTION THEREOF. ONE MUST BE ADA COMPLIANT.

SERVICE SINK: PROVIDE ONE PER FLOOR.

SHOWERS: NOT REQUIRED FOR USE GROUP A-4.

NATIONAL FIRE PROTECTION ASSOCIATION – NFPA 10 – PORTABLE FIRE EXTINGUISHERS

SECTION 5.1 – BASED UPON THE BUILDING USAGE, THE EXTINGUISHER TYPE SHALL BE COMBINATION A-B-C. (ARCHITECTS NOTE: POSSIBLE FIRES WITHIN THIS BUILDING WILL BE TYPE A, COMMON FLAMMABLE MATERIAL, AND TYPE C, ENERGIZED ELECTRICAL EQUIPMENT. TYPE K EXTINGUISHERS ARE NOT REQUIRED, BECAUSE THE CONCESSION STAND SHALL NOT CONTAIN COOKING EQUIPMENT.)

SECTION 5.6 – REQUIREMENTS FOR EXTINGUISHERS ARE REFERRED TO NFPA-1 "FIRE CODE", WHICH REQUIRES EXTINGUISHERS IN ALL ASSEMBLY USE GROUPS, REGARDLESS OF THE PRESENCE OF AUTOMATIC SUPPRESSION SYSTEMS.

SECTION 6.2 – INSTALLATION FOR CLASS A FIRES: MAXIMUM TRAVEL DISTANCE TO ANY EXTINGUISHER SHALL NOT EXCEED 75 FEET.

BLEACHER CONFIGURATION AND CAPACITY CRITERIA:

BLEACHER CAPACITY:

WHEN ROW IS OPEN AT BOTH ENDS: 100 PERSONS MAXIMUM PER ROW.

100 PERSONS x 18 INCHES PER PERSON = 180 FEET.

WHEN ROW IS OPEN AT ONE END ONLY: 7 PERSONS MAXIMUM.

7 PERSONS x 18 INCHES PER PERSON = 10.5 FEET.

MINIMUM ROW DEPTH CONFIGURATION: 10 INCH SEAT DEPTH + 12 INCH FOOT BOARD = 22 INCH TOTAL ROW DEPTH.

MINIMUM BLEACHER EGRESS AISLE CONFIGURATION: 0.375 INCHES PER PERSON, BUT NOT LESS THAN THE FOLLOWING:

SEATING ROWS ON BOTH SIDES: 48 INCHES CLEAR WIDTH REQUIRED.

SEATING ROW ON ONE SIDE: 36 INCHES CLEAR WIDTH REQUIRED.

HANDRAIL MUST BE WITHIN A 30 INCH REACH, WHEN EGRESS AISLE IS STEP DOWN CONFIGURATION.

GUARDS REQUIRED ON BLEACHERS AT THE FOLLOWING LOCATIONS:

- ALONG OPEN SIDE WALKING SURFACES.
- CROSS AISLES.
- STEPPED AISLES.
- RAMP AND LANDINGS.

WHERE AN ELEVATION CHANGE OF 30 INCHES OR LESS OCCURS BETWEEN A CROSS AISLE AND THE ADJACENT FLOOR OR GRADE BELOW, GUARDS NOT LESS THAN 28 INCHES ABOVE THE FLOOR SHALL BE PERMITTED.

A GUARD WITH A MINIMUM HEIGHT OF 28 INCHES SHALL BE PROVIDED WHERE THE FLOOR OR FOOT BOARD ELEVATION IS MORE THAN 30 INCHES ABOVE THE FLOOR OR GRADE BELOW, AND THE GUARD WOULD OTHERWISE INTERFERE WITH THE SIGHTLINES OF THE IMMEDIATELY ADJACENT SEATING.

MAXIMUM EGRESS TRAVEL DISTANCE (WITHIN A FULLY SPRINKLERED BUILDING)

250 LINEAR FEET MEASURED FROM THE MOST REMOTE BLEACHER SEAT, AND OTHER LOCATIONS WITHIN THE RINK AREA, TO THE NEAREST EXIT DOOR.

30 LINEAR FEET: MEASURED FROM MOST REMOTE BLEACHER SEAT TO A POINT ON THE BLEACHER ASSEMBLY WHERE THE OCCUPANT HAS A CHOICE TO EXIT TOWARDS THE LEFT-SIDE EXIT DOOR OR THE RIGHT-SIDE EXIT DOOR. THIS REQUIREMENT IS INCLUDED WITHIN THE 250 LINEAR FEET REQUIREMENT.

REQUIRED QUANTITY OF ACCESSIBLE WHEELCHAIR SPACES ON BLEACHERS

BLEACHER CAPACITY	MIN. SPACES
4 TO 25	1
26 TO 50	2
51 TO 100	4
100 TO 500	5
501 TO 1000	6
501 TO 5000	6, PLUS 1 FOR EACH 150, OR FRACTION THEREOF.

2018 ASHRAE 90.1 – BUILDING ENVELOPE REQUIREMENTS FOR NEW ADDITION

CLIMATE ZONE FOR MIDDLESEX COUNTY, NEW JERSEY:	4A.
ROOF MINIMUM R-VALUE: CONTINUOUS INSULATION COMPLETELY ABOVE DECK	R-30
WALL MINIMUM R-VALUE: CONTINUOUS INSULATION ON STEEL FRAMED WALL	R-20.5

STRUCTURAL LOADS

IBC TABLE 1608.2 "GROUND SNOW LOADS"	30 POUNDS PER SQUARE FOOT
FRENCH & HANDELLO (GEOTECHNICAL REPORT FINDINGS): MAXIMUM SOIL BEARING CAPACITY:	2,000 POUNDS PER SQUARE FOOT
MINIMUM RECOMMENDED SPREAD FOOTING WIDTH:	24 INCHES
MINIMUM RECOMMENDED DEPTH TO BOTTOM OF SPREAD FOOTING:	42 INCHES

2017 NATIONAL ELECTRICAL CODE – REGARDING ELECTRICAL EQUIPMENT ENCLOSURES

REFER TO T & M ASSOCIATES DRAWINGS FOR ADDITIONAL ELECTRIC CODE REQUIREMENTS.

SECTION 110.3.3: ALL PERSONNEL DOORS ACCESSING ROOMS, HOUSING ELECTRICAL EQUIPMENT, SHALL BE EQUIPPED WITH PANIC HARDWARE.

PROJECT SUMMARY

THIS DRAWING SET CONTAINS LIFE SAFETY, ARCHITECTURAL AND REFRIGERATION DRAWINGS.

ANOTHER DRAWING SET HAS BEEN PREPARED BY T&M ASSOCIATES, WHICH CONTAINS THE FOLLOWING DISCIPLINES: CIVIL, STRUCTURAL, FIRE PROTECTION, PLUMBING, MECHANICAL AND ELECTRICAL.

BOTH SETS COMPLIMENT EACH OTHER AND WORK TOGETHER AS IF THEY WERE ONE DRAWING SET.

SUMMARY OF DEMOLITION WORK:

PARTIAL REMOVAL OF EXISTING PERIMETER WALL PANELS.


SUMMARY OF NEW CONSTRUCTION WORK:

- INSTALLATION OF NEW NHL REGULATION SIZE HOCKEY RINK, CHILLER & DEHUMIDIFICATION SYSTEMS.
- INSTALLATION OF FREESTANDING ALUMINUM BLEACHERS, EQUIPPED WITH ACCESS STAIRS AND RAMPS.
- INSTALLATION OF INDIVIDUAL SINGLE-USE RESTROOMS, OF WHICH THREE ARE EQUIPPED WITH BABY CHANGING STATIONS.
- INSTALLATION OF A CONCESSION STAND, WHICH WILL NOT INCLUDE GRILLES, GRIDLES OR FRYERS.
- INSTALLATION OF FIVE TEAM LOCKER ROOMS, WITH DEDICATED RESTROOMS AND SHOWERS.
- INSTALLATION OF A COACHES AND OFFICIALS LOCKER ROOMS, WITH DEDICATED RESTROOMS.
- FIXTURES WITHIN DEDICATED RESTROOMS ARE NOT INCLUDED AS THE MINIMUM REQUIRED PLUMBING FIXTURES, BECAUSE THE PUBLIC IS NOT PROVIDED ACCESS TO THEM.
- INSTALLATION OF AN INTERIOR STAIR AND RAMP SYSTEM, TO ACCOMMODATE THE RAISED HOCKEY RINK FLOOR LEVEL. (RINK IS RAISED TO AVOID INTERFERENCE WITH THE BELOW-GRADE, RIGID FRAME, STRUCTURAL TIE-RODS.)

DRAWING INDEX

- G1.1 COVER SHEET
- G2.1 LOWER LEVEL BUILDING KEY PLAN
- G2.2 PARTIAL LOWER LEVEL LIFE SAFETY PLAN
- G2.3 ROOF BUILDING KEY PLAN
- A1.1 PARTIAL LOWER LEVEL DEMOLITION PLAN
- A1.2 DEMOLITION BUILDING CROSS SECTIONS
- A2.1 PARTIAL LOWER LEVEL CONSTRUCTION FLOOR PLAN
- A2.2 PARTIAL UPPER LEVEL CONSTRUCTION FLOOR PLAN
- A2.3 PARTIAL LOWER LEVEL FLOOR PLANS AT LOCKER ROOMS AND PUBLIC RESTROOMS
- A2.4 CONCESSION STAND PLANS, ELEVATIONS AND DETAILS
- A2.5 ELECTRICAL / ZAMBONI ROOM PLANS, ELEVATIONS AND DETAILS
- A3.1 EXTERIOR ELEVATIONS AND PARTITION TYPES
- A3.2 CONSTRUCTION BUILDING CROSS SECTIONS
- A3.3 WALL SECTIONS
- A3.4 WALL SECTIONS
- A3.5 WALL SECTIONS
- A3.6 WALL SECTIONS
- A3.7 WALL SECTIONS
- A4.1 INTERIOR ELEVATIONS, RESTROOM ACCESSORY SCHEDULE
- A4.2 FREESTANDING BLEACHER PLAN AND ELEVATION
- A5.1 DOOR & WINDOW SCHEDULES, DOOR & WINDOW TYPES AND DETAILS, WALL ACCESS DOOR SCHEDULE
- A6.1 ROOM FINISH PLAN, ROOM FINISH SCHEDULE, SYMBOL LEGEND
- A7.1 REFLECTED CEILING PLAN & CEILING DETAILS
- A7.2 REFLECTED CEILING PLANS
- A8.1 ICE RINK LINE MARKING PLAN
- R-1 RINK REFRIGERATION PLAN
- R-2 RINK FLOOR DETAILS
- R-3 RINK FLOOR DETAILS
- R-4 REFRIGERATION PROCESS AND INSTRUMENTATION DIAGRAM

NEW SHEET

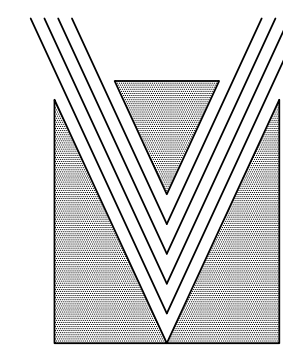

THE VAUGHN COLLABORATIVE
ARCHITECTURE - PLANNING - INTERIOR DESIGN

300 PHILLIPS BLDG. AVENUE, SUITE 500, EWING, NJ 08618
TEL: 609-530-7400 • FAX: 609-530-7418
P.O. BOX 354, WASHINGTON CROSSING, PA 18977
TEL: 215-493-2701

The Club at Woodbridge
INTERIOR ICE RINK

585 Main Street Woodbridge, New Jersey 07095

NO.	DATE	REVISIONS	NO.	DATE	REVISIONS
n/a	July 22, 2020	ISSUE FOR BID			
△	Aug. 19, 2020	ADDENDUM NO. 1			
△	Aug. 31, 2020	ADDENDUM NO. 2			
n/a	Oct. 09, 2020	PERMIT REVIEW			
△	Nov. 25, 2020	BLDG. CODE REVIEW - 2nd RAMP REQUIRED			

DRAWING NAME	SCALE:	AS NOTED	DRAWING NO.
COVER SHEET			G1.1
	DRAWN BY:	MFF	
	CHECKED BY:	MFF, WB, CV	
	COMM. NO.	18-27905	
	DATE:	July 22, 2020	

MICHAEL J. POLY, P.E.
NJ LICENSE 21A0157608