



PORT AUTHORITY
TRANS-HUDSON CORPORATION

GANNETT FLEMING, P.C.
ENGINEERS AND ARCHITECTS

George R. Campanella
GEORGE R. CAMPANELLA
N.J. Professional Engineer # 24GE04252600



No.	Date	Revision	Approved

ENGINEERING DEPARTMENT

**JOURNAL
SQUARE
TRANSPORTATION
CENTER**

ELECTRICAL

Title
**BUS TERMINAL
ESCALATOR REPLACEMENT**

**ESCALATOR'S 9,10,11, & 12
PLAN AND ELEVATION**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.


All recipients of Contract documents, including bidders and those who do not bid and their prospective subcontractors and suppliers who may receive all or a part of the Contract documents or copies thereof, shall make every effort to ensure the secure and appropriate disposal of the Contract documents to prevent further disclosure of the information contained in the documents. Secure and appropriate disposal includes methods of document destruction such as shredding or arrangements with release handlers that ensure that third persons will not have access to the documents' contents either before, during, or after disposal. Documents may also be returned for disposal purposes to the Contract Desk on the 3rd Floor, 3 Gateway Center, Newark, NJ 07102 or the office of the Director of Procurement, One Madison Avenue, 7th Floor, New York, NY 10010.

T. GILLEN A. CONCHADO G. CAMPANELLA
Designed by Drawn by Checked by

Date 11/17/2008


Contract Number PAT-214.004

Drawing Number **E007**
PID# 07957000

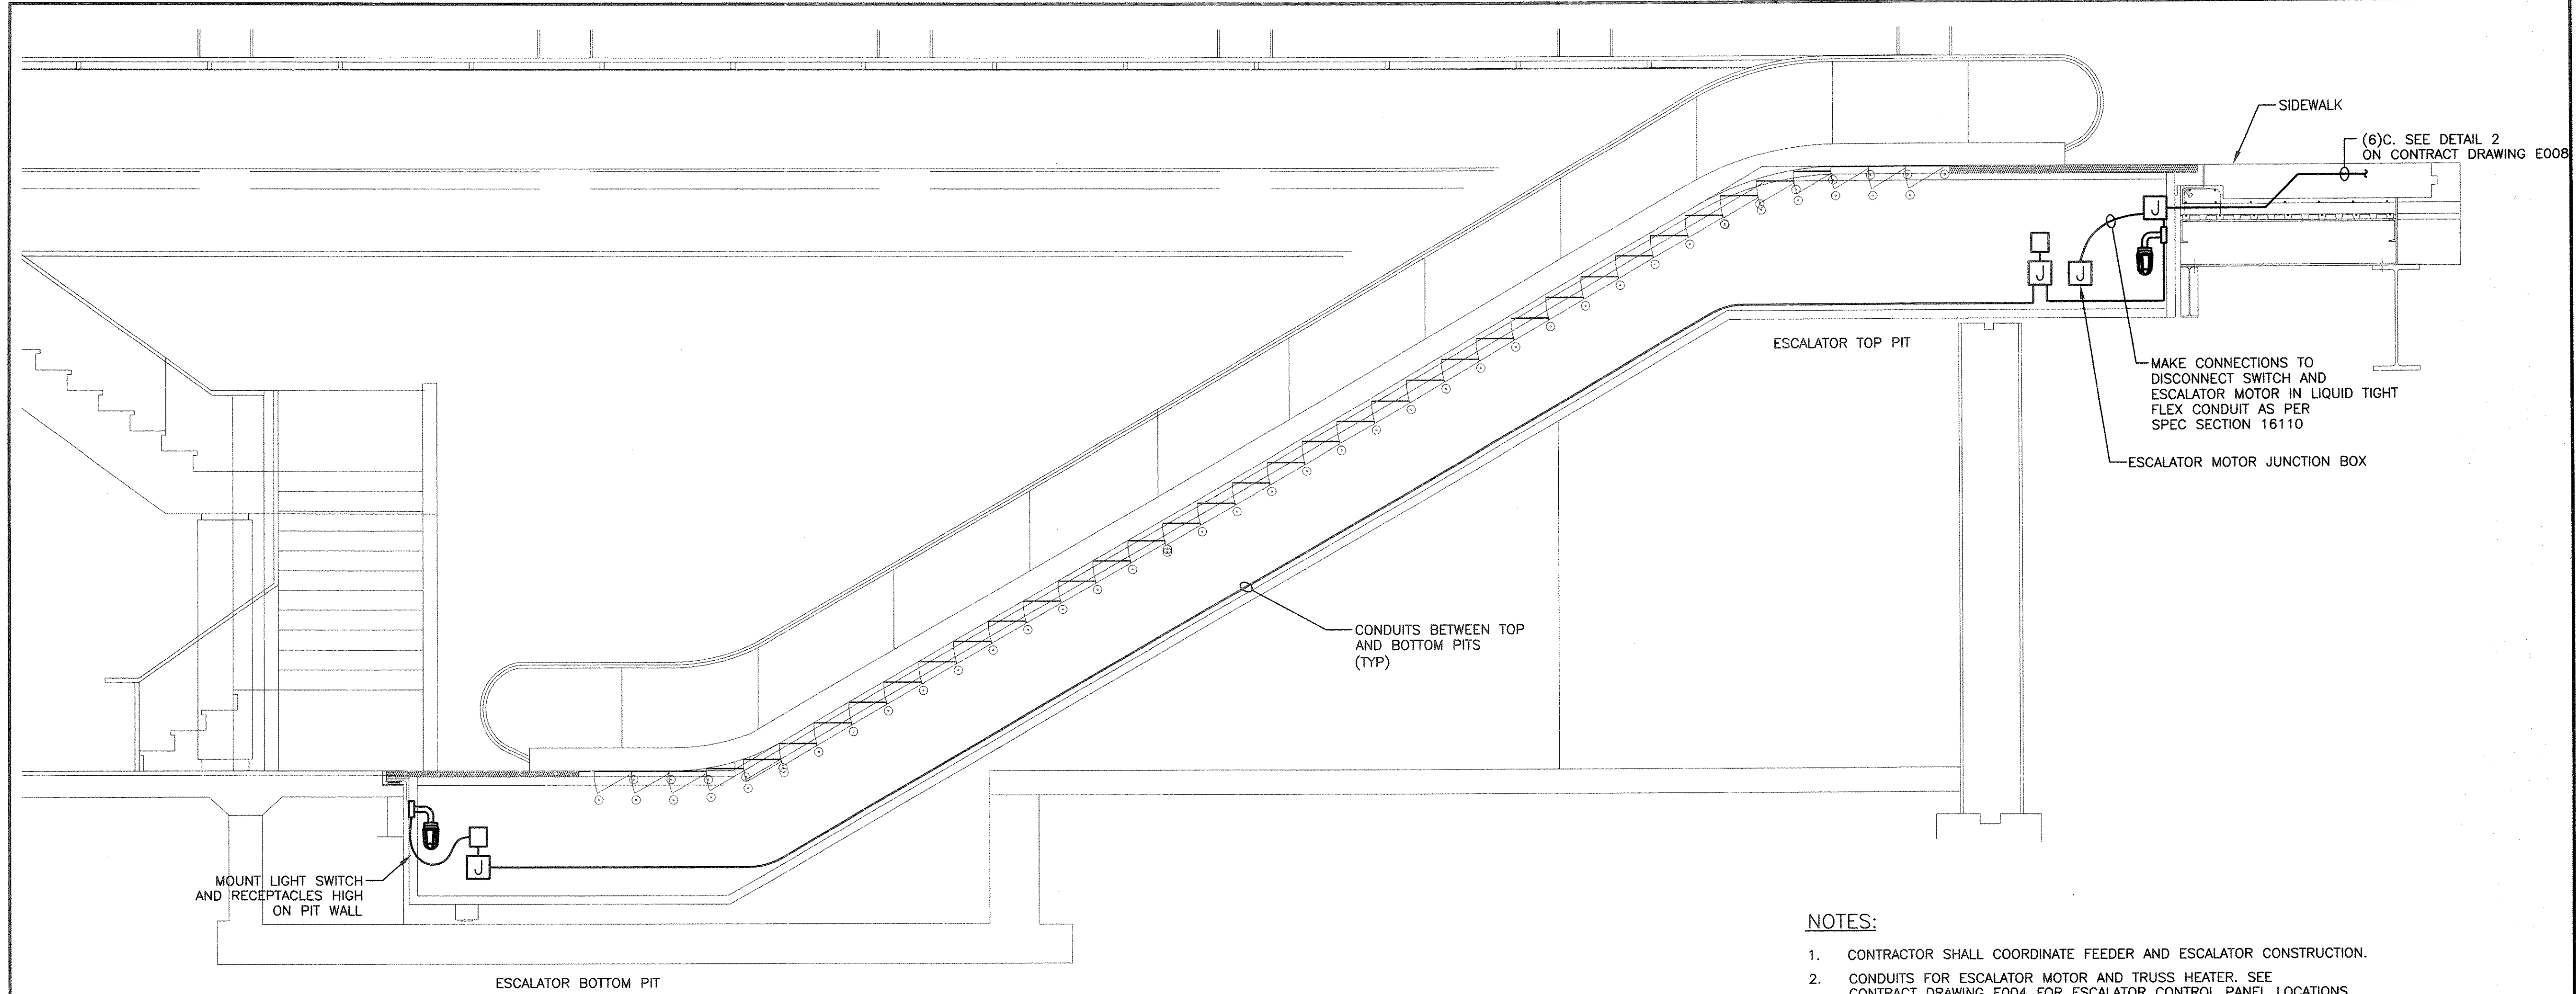

E 1 ESCALATOR'S 9, 10, 11, & 12 ELEVATION
E007
SCALE IN FEET

- NOTES:**
1. CONTRACTOR SHALL COORDINATE FEEDER AND ESCALATOR CONSTRUCTION.
 2. CONDUITS FOR ESCALATOR MOTOR AND TRUSS HEATER. SEE CONTRACT DRAWING E004 FOR ESCALATOR CONTROL PANEL LOCATIONS.
 3. SEE CONTRACT DRAWINGS P004, P005, P006 AND S014 FOR SUMP INSTALLATION DETAILS. NOTE SUMP PIT LOCATIONS ALTERNATE ESCALATOR SIDES. COORDINATE CONSTRUCTION.
 4. PROVIDE DRY CONTACT DIGITAL INPUT SIGNAL FROM HIGH LEVEL ALARM IN ESCALATOR SUMP PIT TO ESCALATOR CONTROLLER. FOR ESCALATORS 5, 6, 7, 8, 9 AND 10.

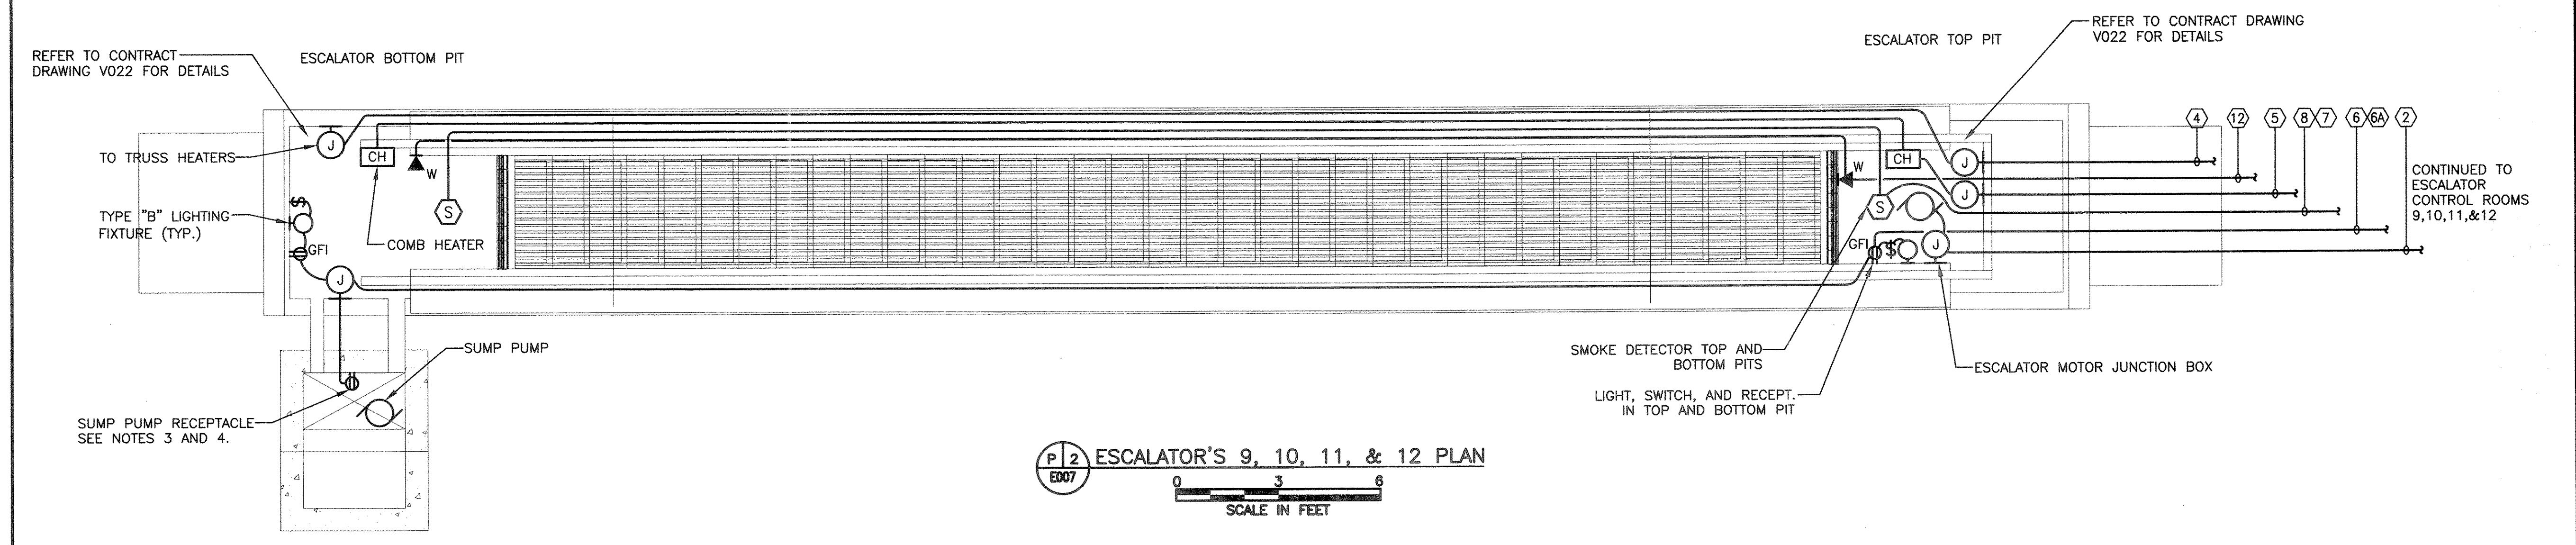

P 2 ESCALATOR'S 9, 10, 11, & 12 PLAN
E007
SCALE IN FEET